LFC500N OSY

Colt[™] Series LFC500, LFC500N, LFC500Z







- Extremely Compact Design
- 70% Lighter than Traditional Designs
- 304 (Schedule 40) Stainless Steel Housing & Sleeve
- Groove Fittings Allow Integral
 Pipeline Adjustment
- Patented Link Check Provides
 Lowest Pressure Loss
- Unmatched Ease of Serviceability
- Replaceable Check Disc Rubber
- Available with Grooved Butterfly Valve Shutoffs
- Bottom Mounted Cast Stainless
 Steel Relief Valve
- Metered Bypass to Detect Leakage or Theft of Water from the Fire Sprinkler System

The wetted surface of this product contacted by consumable water contains less than 0.25% of lead by weight. The Colt LFC500, LFC500N, LFC500Z Reduced Pressure Detector Assemblies provide protection to the potable water system from contamination in accordance with national plumbing codes. The Colt LFC500, LFC500N, LFC500Z are normally used in health-hazard applications to protect against backsiphonage, backpressure and the fouling of either check valve. The Colt LFC500, LFC500N, LFC500Z are used to monitor unauthorized use of water from the fire protection system. The Colt LFC500, LFC500N, LFC500N, LFC500Z feature Lead Free construction to comply with Lead Free* installation requirements.

Specifications

The Colt LFC500, LFC500N, LFC500Z Reduced Pressure Detector Assemblies shall consist of two independent Link Check modules, a differential pressure relief valve located between and below the two modules, two drip tight shutoff valves, and required test cocks. Link Check modules and relief valve shall be contained within a sleeve accessible single housing constructed from 304 (Schedule 40) stainless steel pipe with groove end connections. Link Checks shall have reversible elastomer discs and in operation produce drip tight closure against the reverse flow of liquid caused by backpressure or backsiphonage. The bypass assembly consists of a meter registering either gallon or cubic measurements, a reduced pressure zone assembly and required test cocks. Assembly shall be Colt LFC500, LFC500N, LFC500Z as manufactured by the Ames Company.

NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Job Name	Contractor
Job Location	Approval
Engineer	Contractor's P.O. No
Approval	Representative

Ames Fire & Waterworks product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Ames Fire & Waterworks Technical Service. Ames Fire & Waterworks reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Ames Fire & Waterworks products previously or subsequently sold.

Configurations

- Horizontal
- "Z" pattern horizontal
- "N" pattern horizontal

Materials

- Housing & Sleeve: 304 (Schedule 40) Stainless Steel
- Elastomers: EPDM, Silicone and Buna-N
- Link Checks: Noryl[®], Stainless Steel
- Check Discs: Reversible Silicone or EPDM
- Test Cocks: Lead Free* Bronze Body Nickel Plated
- Pins & Fasteners: 300 Series Stainless Steel
- Springs: Stainless Steel

Pressure — Temperature

Temperature Range: 33°F – 110°F (0.5°C – 43°C) Maximum Working Pressure: 175psi (12.1 bar)


Dimensions — Weights

Available Models

Suffix:


- OSY UL/FM outside stem and yoke resilient seated gate valves
- BFG UL/FM grooved gear operated butterfly valves w/ tamper switch
- *OSY FxG Flanged inlet gate connection and grooved outlet gate connection
- *OSY GxF Grooved inlet gate connection and flanged outlet gate connection
- *OSY GxG Grooved inlet gate connection and grooved outlet gate connection


Available with grooved NRS gate valves - consult factory* Post indicator plate and operating nut available - consult factory* *Consult factory for dimensions.

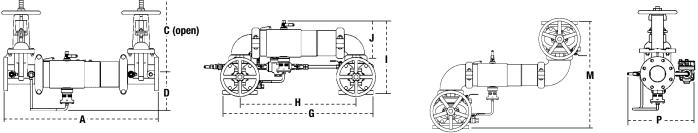


LFC500, LFC500N, LFC500Z

SIZE	DIMENSIONS														WEI	IGHT						
	A		C (OSY) D		G			Н		I		J		М		Р		C500		C500N		
in.	in.	тт	in.	тт	in.	тт	in.	тт	in.	тт	in.	тт	in.	тт	in.	тт	in.	тт	lbs.	kgs.	lbs.	kgs.
2 ¹ / ₂	30¾	781	16¾	416	61/2	165	29 ¹ / ₁₆	738	21 ½	546	15½	393	8 ¹³ ⁄16	223	211/4	540	13 ³ ⁄16	335	142	64	150	68
3	31¾	806	181/8	479	6 ¹¹ /16	170	301/4	768	221/4	565	171//8	435	9 ³ /16	233	23	584	14½	368	162	73	175	79
4	33¾	857	22 ³ / ₄	578	7	178	33	838	23 ½	597	18½	470	9 ¹⁵ /16	252	261/4	667	153/16	386	178	81	201	91
6	431/2	1105	30 1//8	765	81/2	216	443⁄4	1137	331/4	845	23 ³ ⁄16	589	13 ¹ ⁄16	332	321/4	819	19	483	312	142	353	160
8	49 ³ ⁄ ₄	1264	37¾	959	9 ¹¹ / ₁₆	246	54½	1375	401/8	1019	27 ⁷ /16	697	15 ¹¹ /16	399	367/8	937	21 ³ ⁄16	538	497	225	572	259
10	57¾	1467	4 5¾	1162	113/16	285	66	1676	49 ½	1257	32 ½	826	175/16	440	441/2	1124	24	610	797	362	964	437







LFC500NBFG, LFC500ZBFG

SIZE	DIMENSIONS													WEIGHT		
		G	Н		I			J	I	N	F)	C500BFG			
in.	in.	тт	in.	тт	in.	тт	in.	mm	in.	тт	in.	mm	lbs.	kgs.		
2 ¹ / ₂	321/2	826	23	584	15½	394	9 ½	241	19¾	502	15 ¹³ ⁄16	402	81	37		
3	34	864	24	610	16 5⁄16	414	101/16	256	21¼	540	161%	410	84	38		
4	35%	905	251/2	648	17 ¾16	437	10 ¹⁵ ⁄16	279	231/2	597	16%	422	101	46		
6	461/2	1181	35¼	895	201/2	521	13 ½	343	271/4	692	19	483	174	79		

Approvals



For additional approval information please contact the factory or visit our website at www.amesfirewater.com


Capacity


UL/FM Certified Flow Characteristics


N&Z Flow characteristics collected using butterfly shutoff valves.

_____ Horizontal

____ N - Pattern ____ Z - Pattern

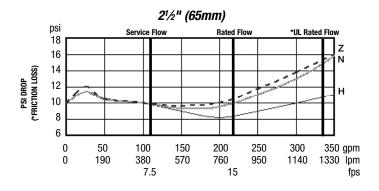


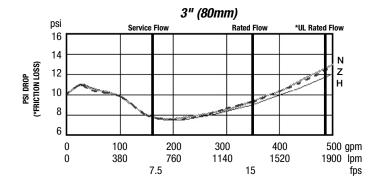


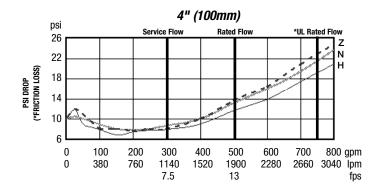


Flow capacity chart identifies valve performance based upon rated water velocity up to 25fps

- Service Flow is typically determined by a rated velocity of 7.5fps based upon schedule 40 pipe.
- Rated Flow identifies maximum continuous duty performance determined by AWWA.
- UL Flow Rate is 150% of Rated Flow and is not recommended for continuous duty.
- AWWA Manual M22 [Appendix C] recommends that the maximum water velocity in services be not more than 10fps.

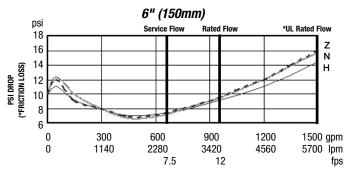

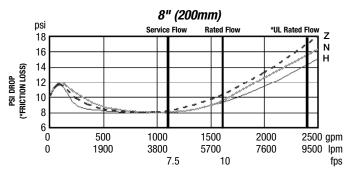

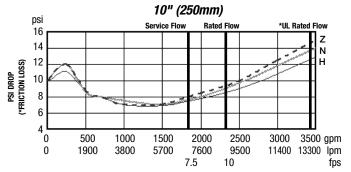

NOTICE Inquire with governing authorities for local installation requirements



A Watts Water Technologies Company

USA: Backflow Tel: (978) 689-6066 • Fax: (978) 975-8350 • AmesFireWater.com USA: Control Valves Tel: (713) 943-0688 • Fax: (713) 944-9445 • AmesFireWater.com Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • AmesFireWater.ca Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • AmesFireWater.com

© 2014 Ames Fire & Waterworks