Maxim[™] Series LFM300, LFM300N



Double Check Detector Assemblies

Sizes: 21/2" - 10"

LEAD FREE*





Features

- · Extremely Compact Design
- 70% Lighter than Traditional Designs
- 304 (Schedule 40) Stainless Steel Housing & Sleeve
- Groove Fittings Allow Integral Pipeline Adjustment
- Patented Tri-Link Check Provides Lowest Pressure Loss
- Unmatched Ease of Serviceability
- Available with Grooved Butterfly Valve Shutoffs
- Available for Horizontal, Vertical or N Pattern Installations
- Replaceable Check Disc Rubber

The Maxim LFM300, LFM300N Double Check Detector Assemblies are used to prevent backflow of pollutants, that are objectionable but not toxic, from entering the potable water supply system. The Maxim LFM300, LFM300N may be installed under continuous pressure service and may be subjected to backpressure. The Maxim LFM300, LFM300N are used primarily on fire line sprinkler systems when it is necessary to monitor unauthorized use of water. For use in non-health hazard applications. The LFM300/LFM300N features Lead Free* construction to comply with Lead Free* installation requirements.

Specifications

The Lead Free* Double Check Detector Assemblies shall consist of two independent Tri-Link Check modules within a single housing, sleeve access port, four test cocks and two drip tight shutoff valves. Tri-Link Checks shall be removable and serviceable, without the use of special tools. The housing shall be constructed of 304 (Schedule 40) stainless steel pipe with groove end connections. Double Check Valve Assemblies shall comply with state codes and standards, where applicable, requiring reduced lead content. Tri-Link Checks shall have reversible elastomer discs and in operation shall produce drip tight closure against the reverse flow of liquid caused by backpressure or backsiphonage. The bypass assembly consists of a meter registering either gallon or cubic feet measurements, a double check valve assembly and required test cocks. Assembly shall be a Maxim LFM300, LFM300N as manufactured by the Ames Company.

NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

*The wetted surface of this product contacted by consumable water contains less than 0.25% of lead by weight.

Job Name	Contractor
Job Location	Approval
Engineer	Contractor's P.O. No.
Approval	Representative

Ames Fire & Waterworks product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Ames Fire & Waterworks Technical Service. Ames Fire & Waterworks reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Ames Fire & Waterworks products previously or subsequently sold.

Configurations

- Horizontal
- · Vertical up
- "N" pattern horizontal

Materials

- Housing & Sleeve: 304 (Schedule 40) Stainless Steel
- · Elastomers: EPDM, Silicone and Buna 'N'
- Tri-Link Checks: Noryl®, Stainless Steel
- · Check Discs: Reversible Silicone or EPDM
- · Test Cocks: Bronze Body Nickel Plated
- · Pins & Fasteners: 300 Series Stainless Steel
- Springs: Stainless Steel

Available Models


- OSY UL/FM flanged outside stem and yoke resilient seated gate valves
- BFG UL/FM grooved gear operated butterfly valves w/tamper switch
- *OSY FxG Flanged inlet gate connection and grooved outlet gate connection
- *OSY GxF Grooved inlet gate connection and flanged outlet gate connection
- *OSY GxG Grooved inlet gate connection and grooved outlet gate connection


Available with grooved NRS gate valves - consult factory* Post indicator plate and operating nut available - consult factory* *Consult factory for dimensions


Pressure — Temperature

Temperature Range: 33°F – 110°F (5°C – 43°C) Maximum Working Pressure: 175psi (12.06 bar)

Dimensions — Weights










LFM300, LFM300N

SIZE			DIMENSIONS WEIGHT																	
	А		C (OSY)		D		G		Н		I		J		Р		M300		M300N	
in	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	lbs.	kgs.	lbs.	kgs.
21/2	30¾	781	16%	416	3½	89	291/16	738	21½	546	15 ¹³ ⁄16	402	813/16	223	13¾6	335	139	63	147	67
3	31¾	806	181/8	479	311/16	94	30½	775	221/4	565	171/8	435	9 3⁄16	233	14½	368	159	72	172	78
4	40½	1029	22 3/4	578	5	127	39¾	1010	301/4	768	20%	518	11 ¹¹ / ₁₆	297	15¾6	386	233	106	256	116
6	47¾	1213	301//8	765	6½	165	40	1016	37½	953	24¾	629	14 ³ ⁄ ₁₆	360	19½	495	404	183	444	201
8	54¾	1391	37¾	959	7½	191	591/8	1502	451/8	1146	28%	721	16¾	425	21½	546	578	262	654	297
10	57¾	1467	45¾	1162	83/16	208	66	1676	491/2	1257	32½	826	17 5⁄16	440	24	610	795	361	965	438







LFM300BFG, LFM300NBFG

SIZE	DIMENSIONS WEIGHT																				
		Α		С		D		G		Н		I		J		Р		M300BFG		M300NBFG	
in.	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.	lbs.	kgs.	
21/2	273/4	705	8	203	31/2	89	297/8	759	21½	546	14 ¹⁵ ⁄ ₁₆	379	813/16	223	13	330	70	32	78	35	
3	281/4	718	85/16	211	311/16	94	30¾	781	221/4	565	157/16	392	93/16	233	13½	343	68	31	81	37	
4	353/4	908	811/16	221	4 ¹³ ⁄ ₁₆	122	39	991	301/4	768	18	457	11 ¹¹ / ₁₆	297	15	381	133	60	156	71	
6	40¾	1035	10	254	6	152	47 ⁷ / ₁₆	1205	37½	953	2011/16	525	14 ³ ⁄ ₁₆	360	19½	495	225	102	265	120	
8	473/4	1213	12 ³ ⁄ ₁₆	310	613/16	173	56	1422	451/8	1146	241//8	613	16¾	425	21½	546	359	163	435	197	

Approvals




For additional approval information please contact the factory or visit our website at www.amesfirewater.com


Capacity

UL/FM Certified Flow Characteristics

Flow characteristics collected using butterfly shutoff valves.

— Horizontal — Vertical ---- N-Pattern

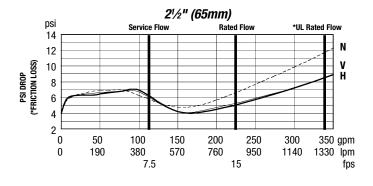

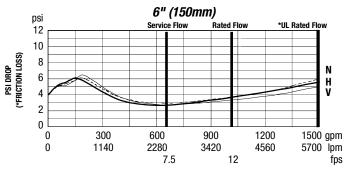

Flow capacity chart identifies valve performance

• Rated Flow identifies maximum continuous duty

• UL Flow Rate is 150% of Rated Flow and is not

• AWWA Manual M22 [Appendix C] recommends


that the maximum water velocity in services be


based upon rated water velocity up to 25fps
Service Flow is typically determined by a rated velocity of 7.5fps based upon schedule 40 pipe.


performance determined by AWWA.


recommended for continuous duty.

not more than 10fps.

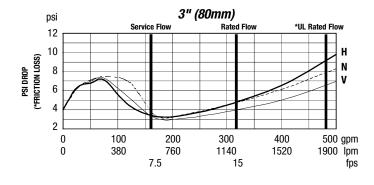

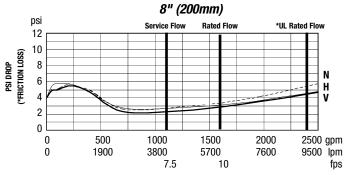

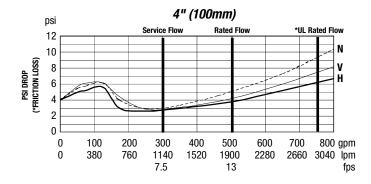

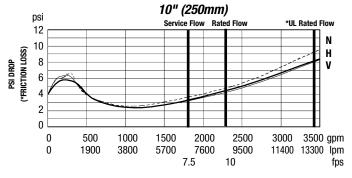

NOTICE

Inquire with governing authorities for local installation requirements

